



HELIFIX VENEER ANCHOR NOTE:
-PRIOR TO INSTALLATION, HELIFIX VENEER ANCHORS MUST BE LOAD TESTED BY A CERTIFIED AGENT. ANCHORS MUST ACHIEVE A MINIMUM AVERAGE ULTIMATE LOAD CAPACITY OF 275 LBS. IF ANCHORS FAIL TO MEET THIS REQUIREMENT, THE SPACING OF THE VENEER ANCHORS WILL NEED TO BE ADJUSTED AS DIRECTED BY THE ENGINEER OF RECORD. LOAD TEST RESULTS SHALL BE SUBMITTED TO THE ENGINEER OF RECORD FOR REVIEW PRIOR TO COMMENCEMENT OF WALL REPAIRS.

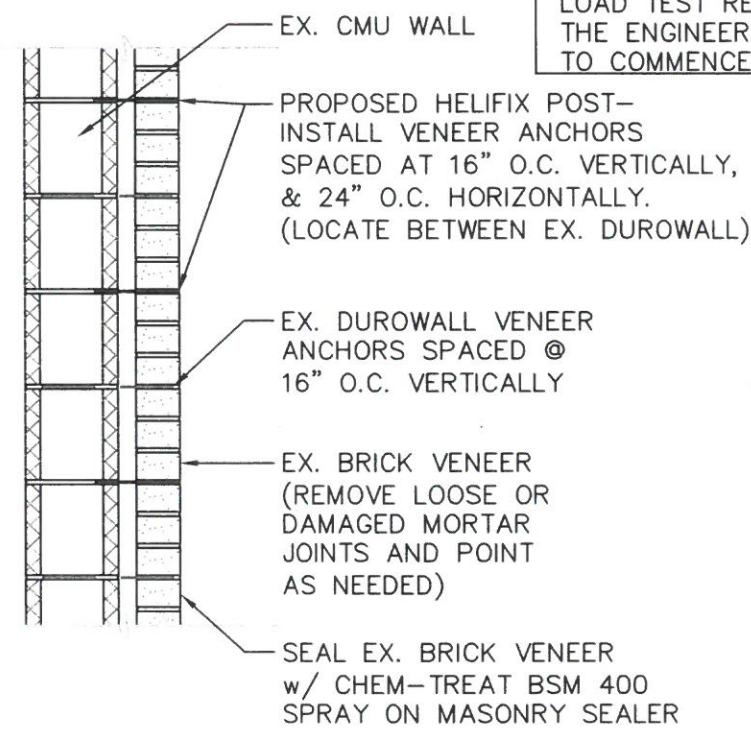


SECTION VIEW

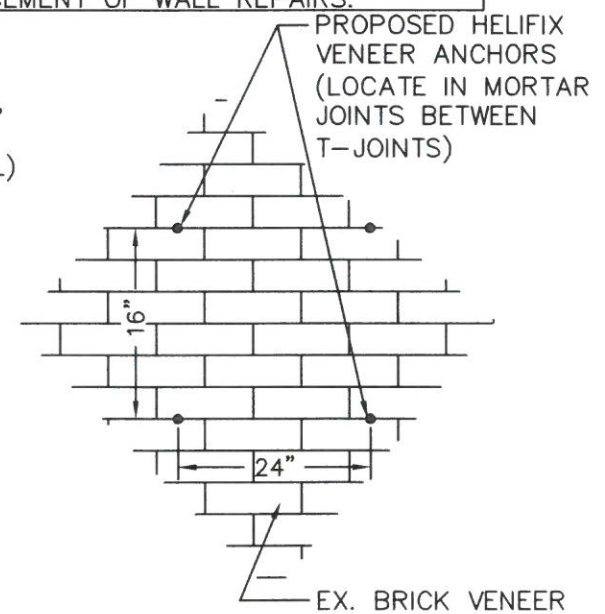

TYP. REPAIR PATTERN ELEVATION VIEW

NOTES:
-ALL WORK SHALL BE PERFORMED IN ACCORDANCE WITH ALL APPLICABLE BUILDING CODES.
-BRICK MORTAR JOINTS SHALL BE REPAIRED AND POINTED WITH TYPE N MORTAR TO MATCH EXISTING.
-PROPOSED VENEER ANCHOR INSTALLATION HOLES SHALL BE CAPPED WITH MATCHING MORTAR.
-ALL PROPRIETARY PRODUCTS SHALL BE INSTALLED OR APPLIED IN ACCORDANCE WITH MANUFACTURER'S RECOMMENDATIONS.

ABBREVIATIONS:
CMU CONCRETE MASONRY UNIT
EX. EXISTING
PR. PROPOSED
W1 MAIN LEVEL WALL SECTION TO BE REPAIRED
W2 ELEVATED WALL SECTION TO BE REPAIRED
W3 EXISTING CEMENTIOUS BOARD CLADDING SYSTEM TO BE REMOVED AND REPLACED WITH E.I.F.S. AND BRICK AS INDICATED IN DETAILS ON SHEETS S2 AND S3.
DS APPROXIMATE LOCATION OF EXISTING DOWNSPOUT THAT IS NOT PROPERLY DRAINING. THESE DOWNSPOUTS SHALL BE COLLECTED AND DRAIN TO DAYLIGHT AWAY FROM THE BUILDING FOUNDATION SYSTEM.

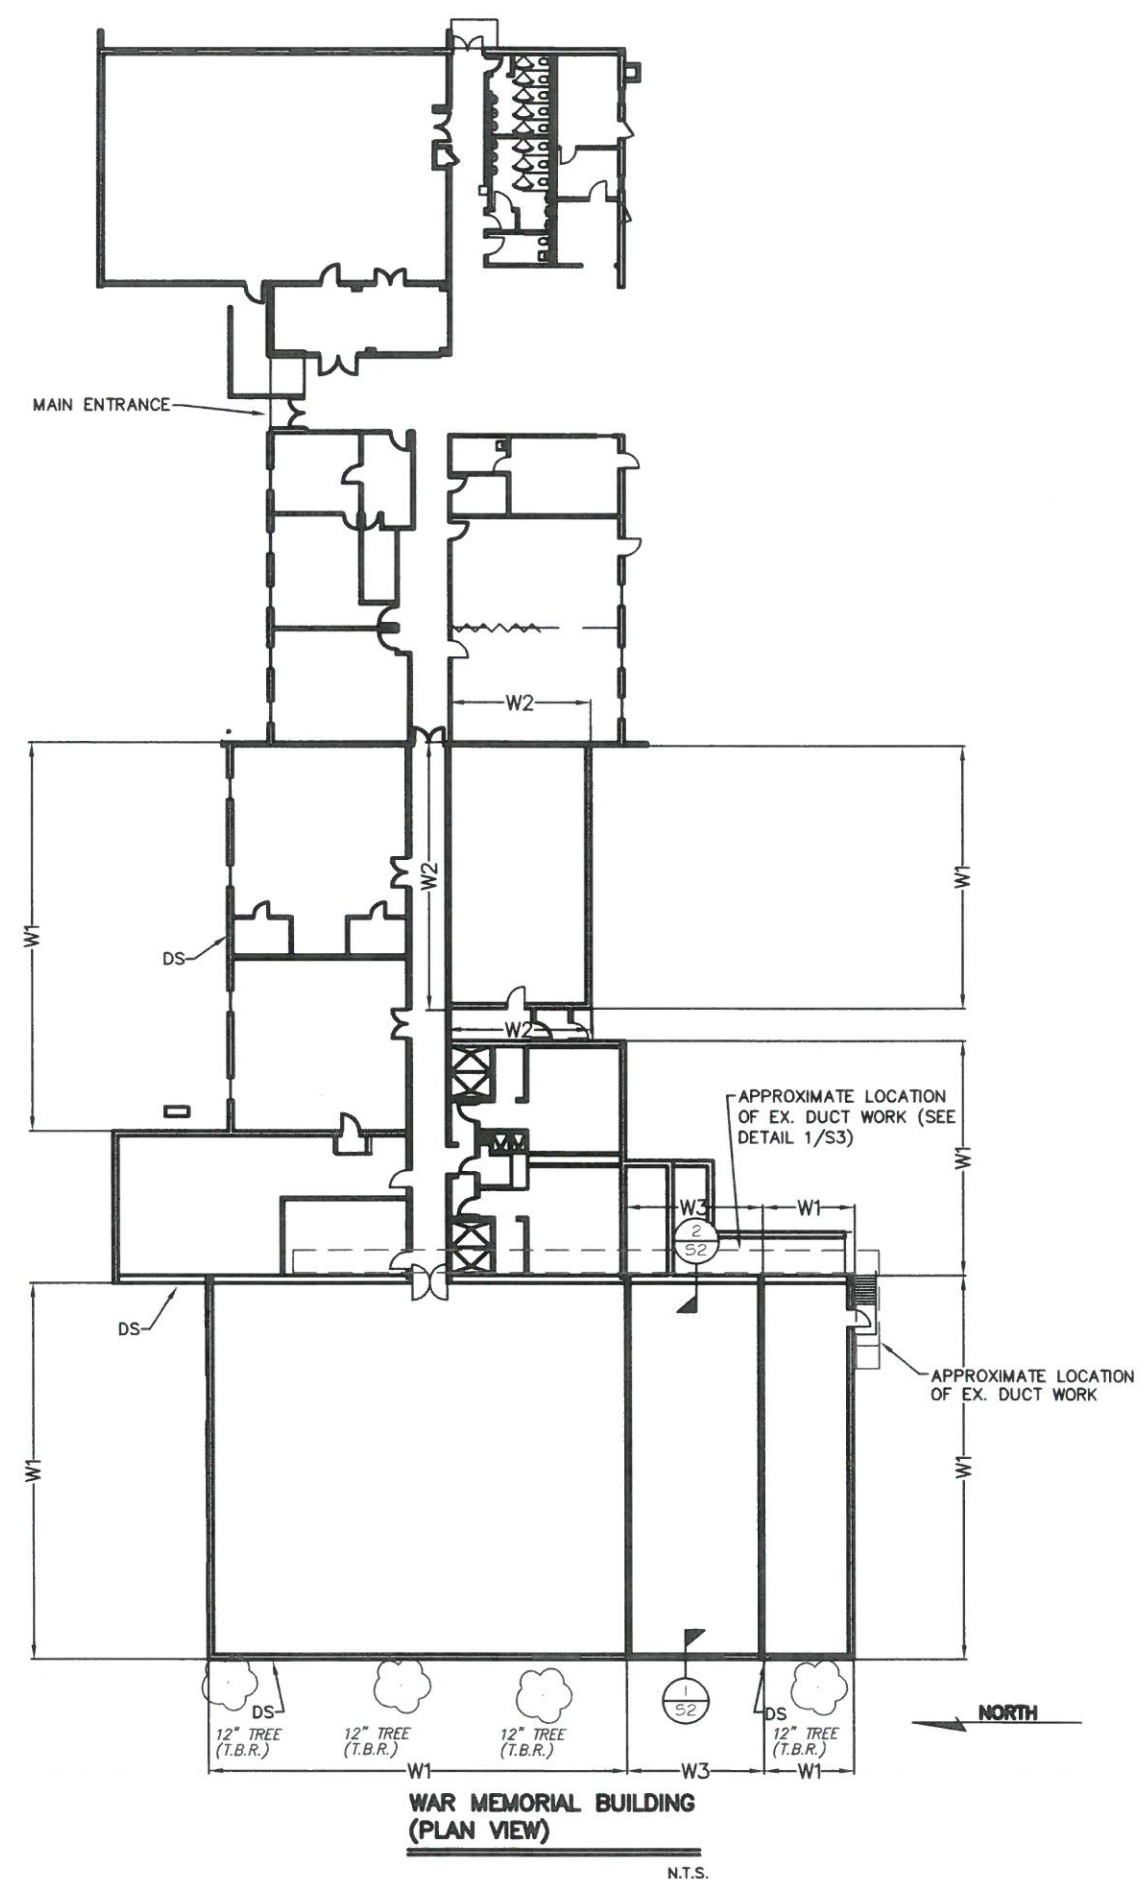


WAR MEMORIAL BUILDING (PLAN VIEW)

N.T.S.


TITLE: WAR MEMORIAL BUILDING: BRICK VENEER REPAIR

Designer:	PROJECT: WAR MEMORIAL BUILDING JIM BARNETT PARK WINCHESTER, VIRGINIA		
	DATE: 09-20-13	SCALE: AS NOTED	PLATE: S1/S3
P-L, PLC Project No: 1305023			

E.I.F.S. NOTE:
 1/2" DEEP V-GROVE CONTROL JOINTS
 SHALL BE CUT IN E.I.F.S. CLADDING
 SYSTEM ON A 4'-0"x4'-0" PATTERN
 TO MATCH EX. CLADDING SYSTEM.

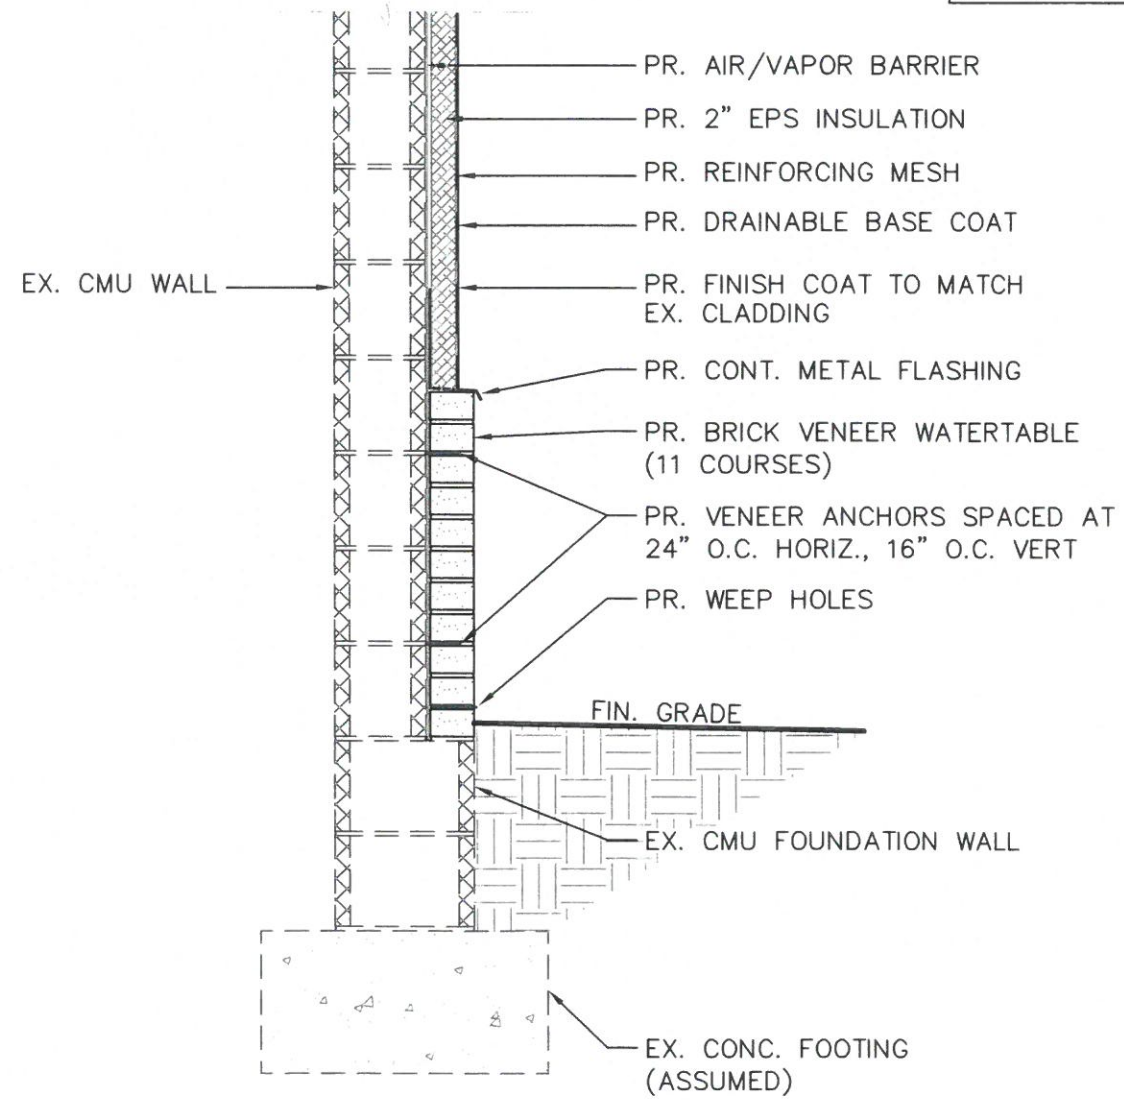

1
S2 WEST WALL WATER TABLE
 DETAIL
 SCALE: 3/4" = 1'-0"

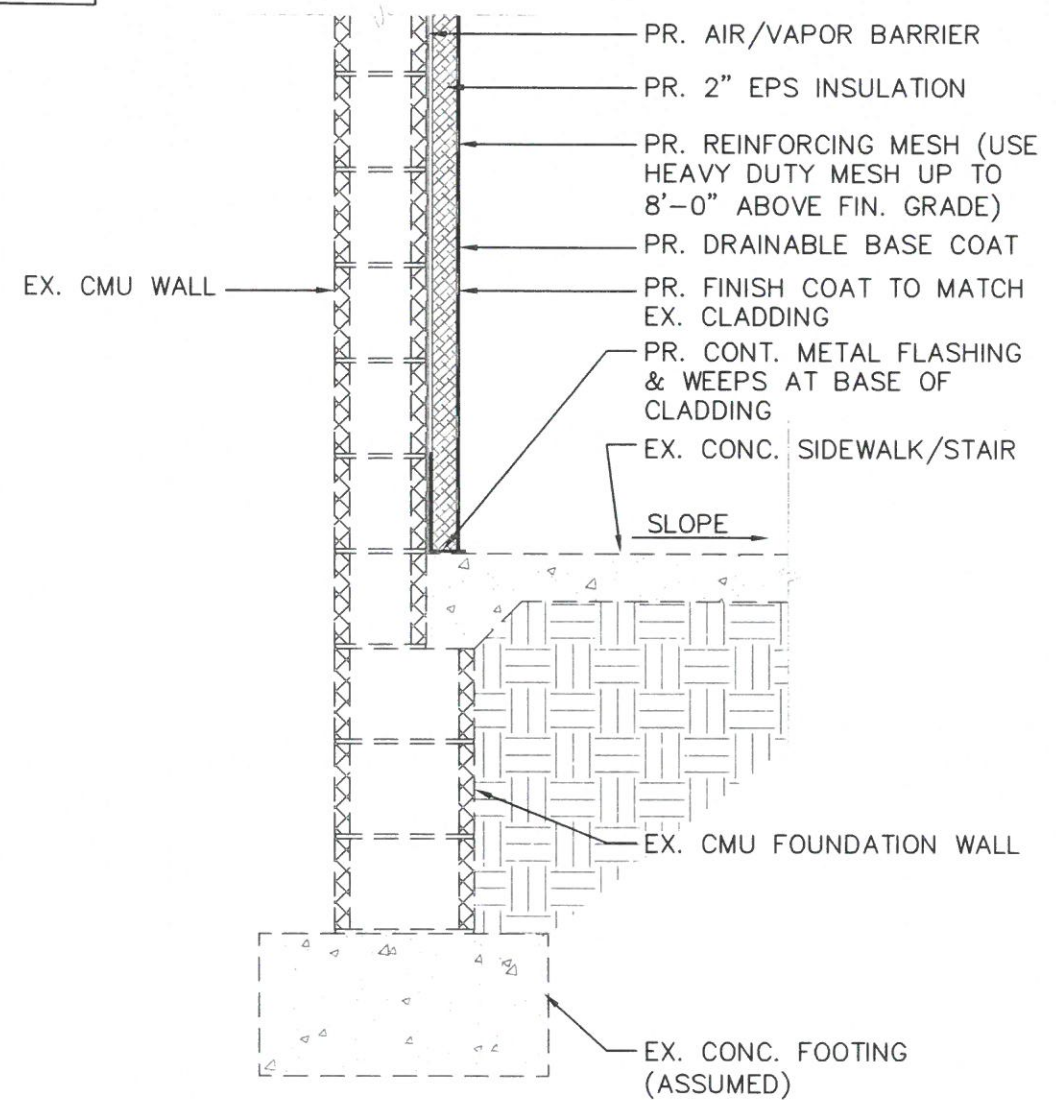


2
S2 EAST WALL E.I.F.S. DETAIL
 SCALE: 3/4" = 1'-0"




WAR MEMORIAL BUILDING: BRICK VENEER REPAIR

TITLE:		WAR MEMORIAL BUILDING: BRICK VENEER REPAIR	
Designer:	PAINTER-LEWIS, P.L.C. 817 CEDAR CREEK GRADE, SUITE 120 WINCHESTER, VA 22601	PROJECT:	
		WAR MEMORIAL BUILDING JIM BARNETT PARK WINCHESTER, VIRGINIA	
		DATE:	09-20-13
		SCALE:	AS NOTED
		PLATE:	S2/S3
		P-L, PLC Project No.: 1305023	

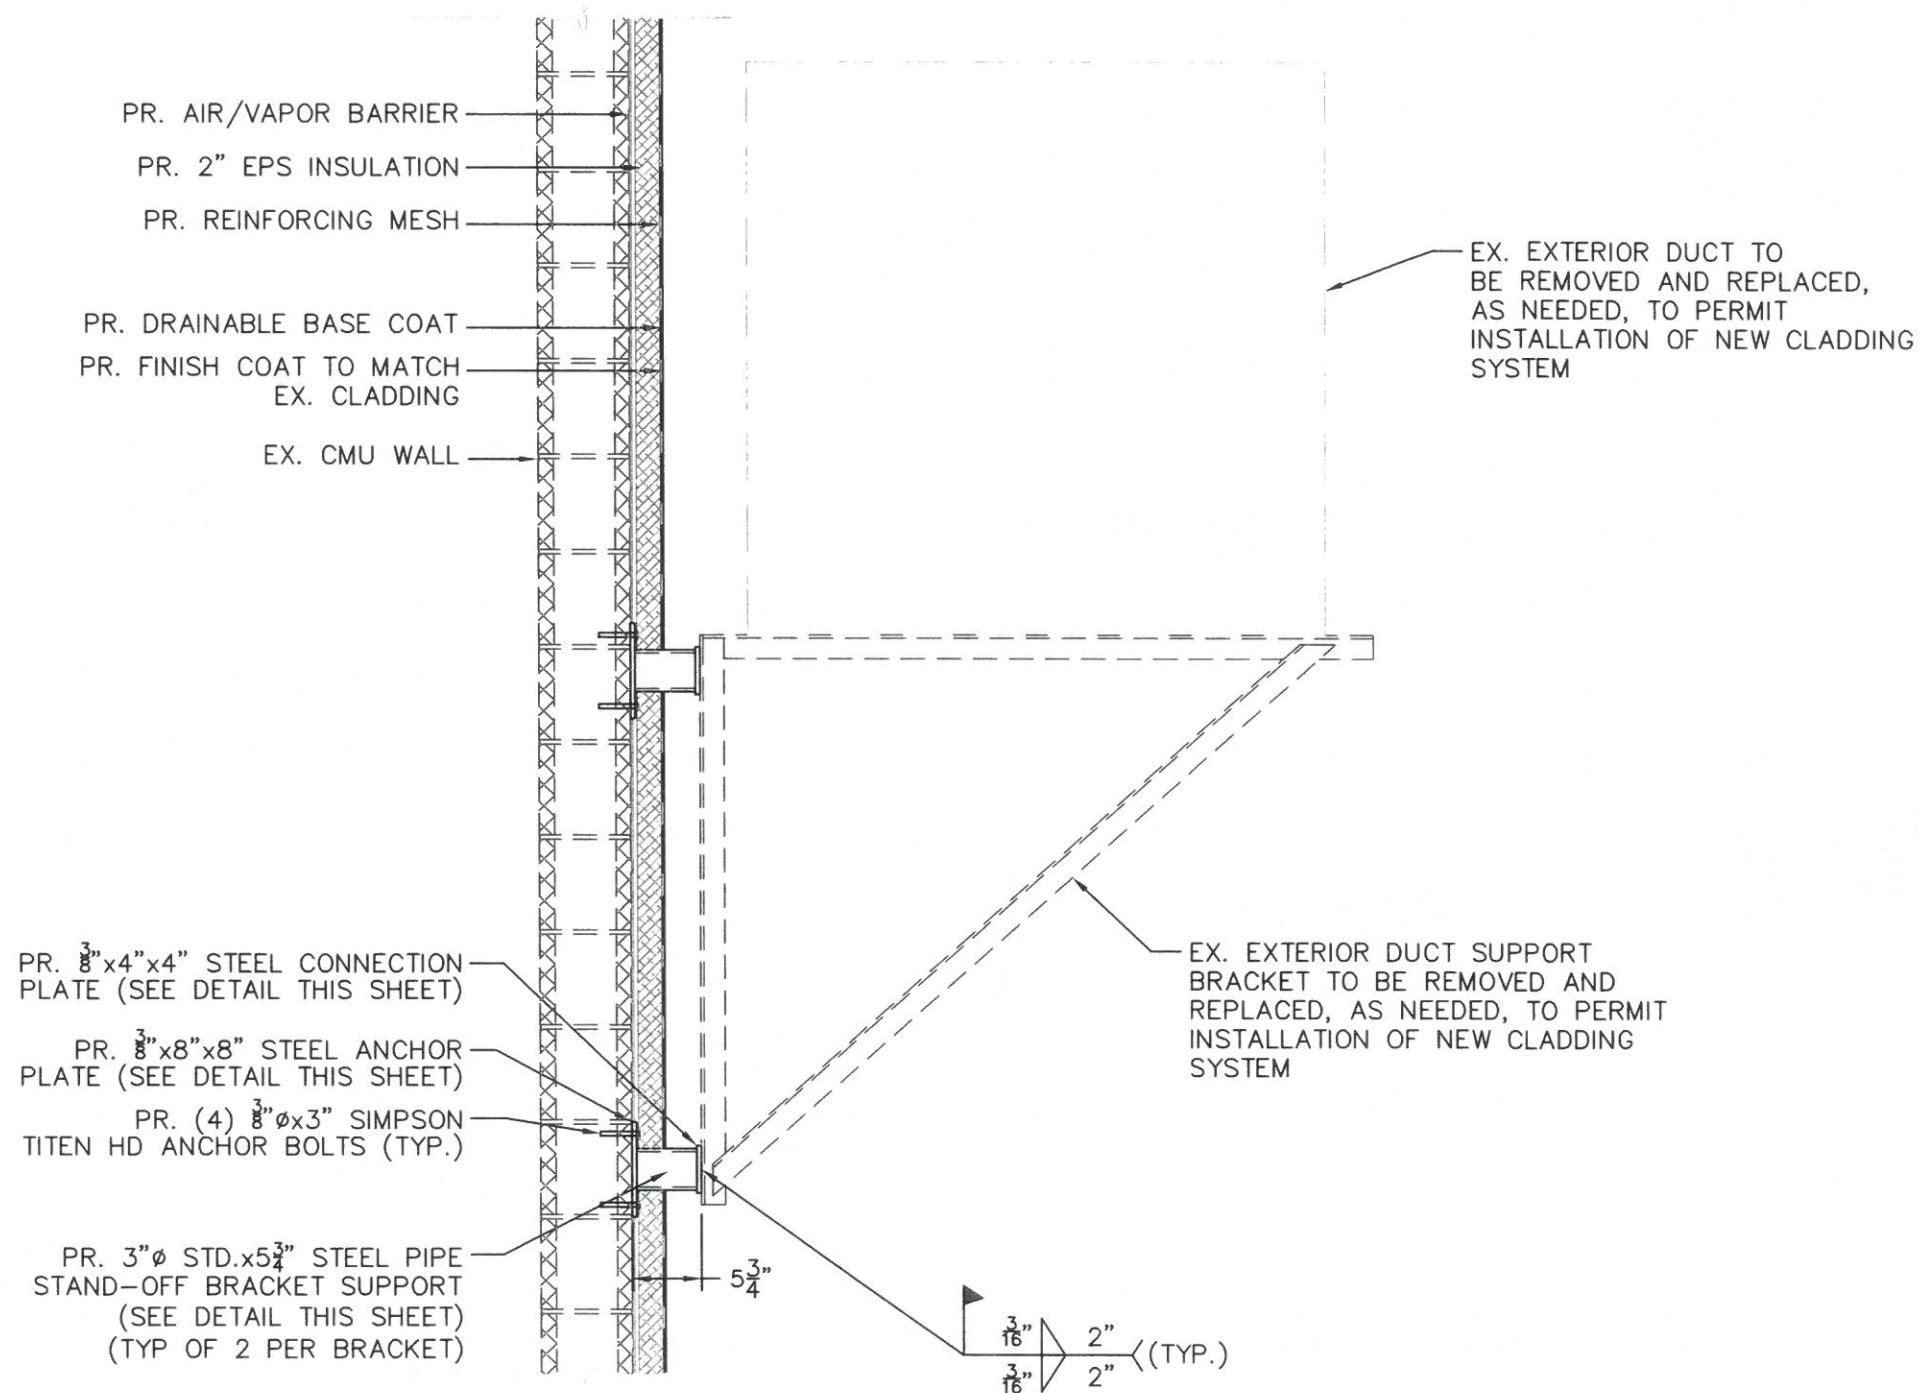

1
S3 EAST WALL DUCT SUPPORT
BRACKET DETAIL

SCALE: 3/4" = 1'-0"

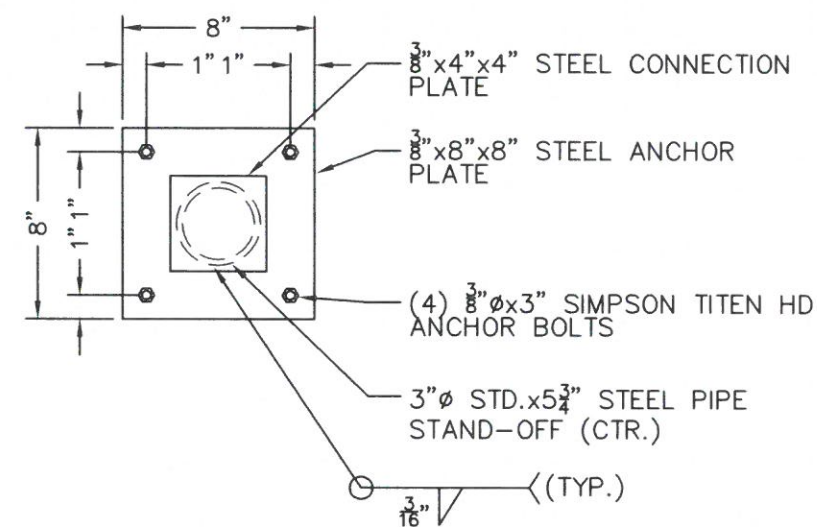

SECT. A-A

SCALE: 1-1/2" = 1'-0"



TITLE:

WAR MEMORIAL BUILDING: BRICK VENEER REPAIR

Designer:

PAINTER-LEWIS, P.L.C.
817 CEDAR CREEK GRADE, SUITE 120 (540) 662-5792
WINCHESTER, VA 22601

PROJECT:

WAR MEMORIAL BUILDING
JIM BARNETT PARK
WINCHESTER, VIRGINIA

DATE: 09-20-13

SCALE: AS NOTED

PLATE: S2/S3

P-L, PLC Project No.: 1305023